


COFFRET BY PASS POWER 2XL T 15 et 20KVA



D1	Inter 4P 100A
BYP	Inter 3P 100A
STATIC	Inter 1P 25A
S2	Inter 2P 100A

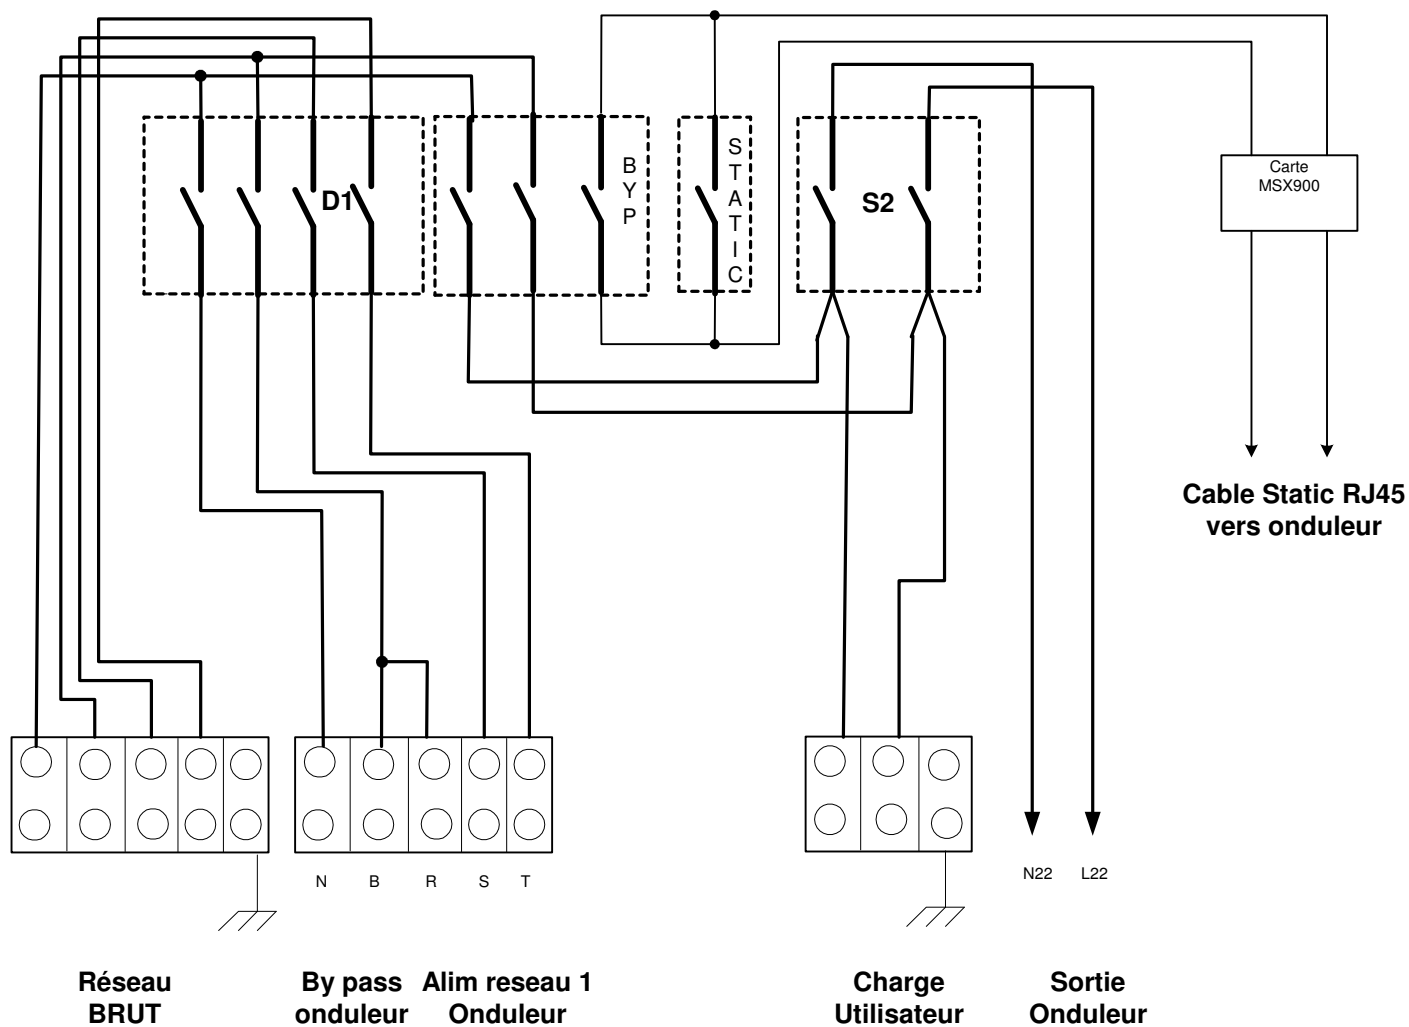

Date	24/06/2011
Visa	MCO
Contrôle	JLH

**COFFRET BYPASS
TRI/MONO
20 KVA**

Rev: 1.00A Date: 24/06/2011